

## Detectable Edge


using a Longitudinal Channelizer

## Detectable Edge

shown on a railing system

### NOTES:

1. To prevent any tripping hazard to pedestrians, ballast shall be located behind or internal to the device. Any support on the front of the device shall not extend into the 48 in. minimum walkway clear space and shall have 0.5 in. maximum height above the walkway surface with approved beveling (see note #9 on page 6K-xxxi for beveling details).
2. Detectable edges for long canes shall be continuous and 6 in. min high above the walkway surface and have color or markings contrasting with the walkway surface.
3. Devices shall not block water drainage from the walkway. A gap height or opening from the walkway surface up to 2 in. maximum height is allowed for drainage purposes.
4. Railings or other objects may protrude a maximum of 4 in. into the walkway clear space when located 27 in. minimum above the walkway surface.
5. Longitudinal channelizing devices for pedestrians shall be 32 in. high or greater.
6. When hand guidance is required, the top rail or top surface shall:
  - be in a vertical plane perpendicular to the walkway above the detectable edge,
  - be continuous at a height of 36 to 38 in. above the walkway surface, and
  - be supported with minimal interference to the pedestrian's hands or fingers.
7. All devices shall be free of sharp or rough edges, and fasteners (bolts) shall be rounded to prevent harm to hands, arms or clothing of pedestrians.
8. All devices used to channelize pedestrian flow should interlock such that gaps do not allow pedestrians to stray from the channelized path.
9. Any pedestrian devices used to provide positive protection (traffic or hazard) for pedestrians or workers shall meet crashworthy requirements appropriate for the barriers' application.

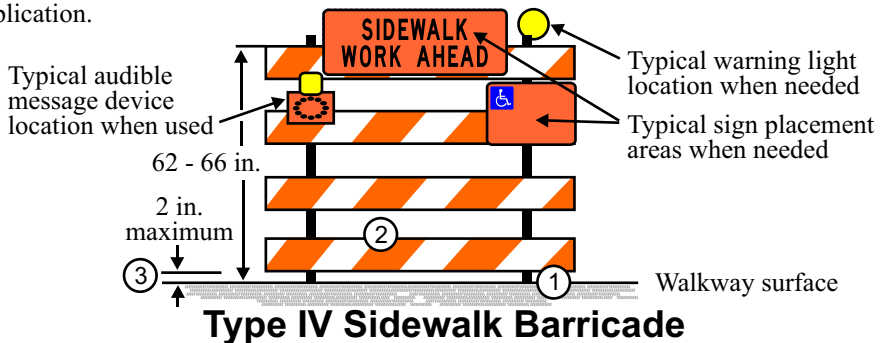


## Typical ADA Pedestrian Devices


Refer to the Mn/DOT TPAR website for additional standards, guidance, and options for designing temporary pedestrian access routes.

<http://www.dot.state.mn.us/trafficeng/workzone/tpar.html>

## Temporary Curb Ramp - Parallel to Curb

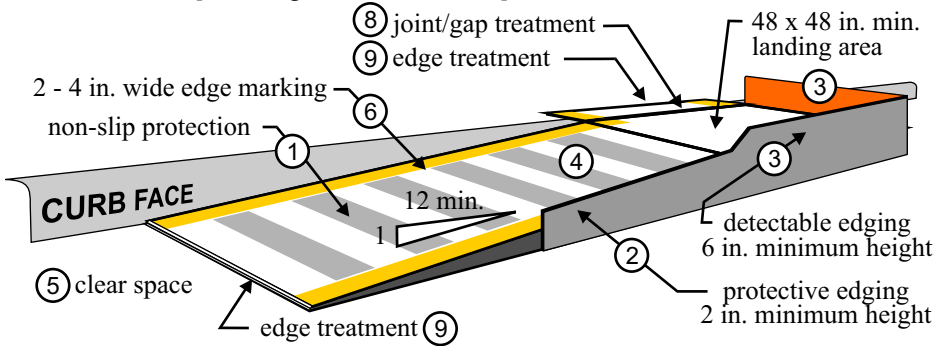

## Temporary Curb Ramp - Perpendicular to Curb

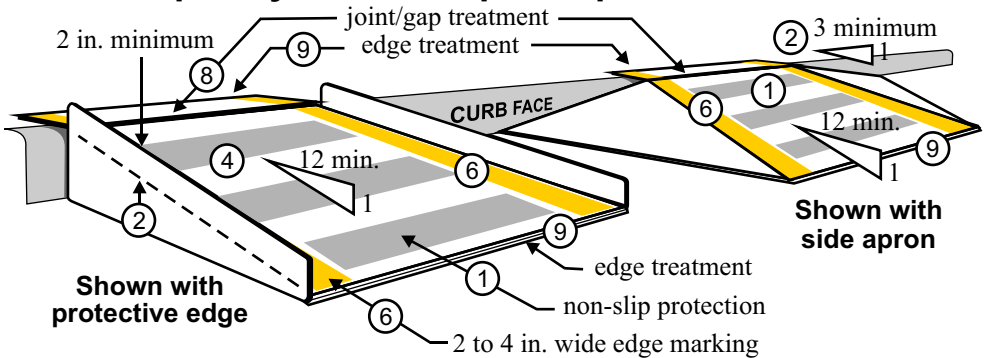

### NOTES:

1. Curb ramps shall be 48 in. minimum width with a firm, stable and non-slip surface.
2. Protective edging with a 2 in. minimum height shall be installed when the curb ramp or landing platform has a vertical drop of 6 in. or greater or has a side apron slope steeper than 1:3 (33%). Protective edging should be considered when curb ramps or landing platforms have a vertical drop of 3 in. or more.
3. Detectable edging with 6 in. minimum height and contrasting color shall be installed on all curb ramp landings where the walkway changes direction (turns).
4. Curb ramps and landings should have a 1:50 (2%) max cross-slope.
5. Clear space of 48 x 48 in. minimum shall be provided above and below the curb ramp.
6. The curb ramp walkway edge shall be marked with a contrasting color 2 to 4 in. wide marking. The marking is optional where color contrasting edging is used.
7. Water flow in the gutter system shall have minimal restriction.
8. Lateral joints or gaps between surfaces shall be less than 0.5 in. width.
9. Changes between surface heights should not exceed 0.5 in. Lateral edges should be vertical up to 0.25 in. high, and beveled at 1:2 between 0.25 in. and 0.5 in. height.

## Typical ADA Pedestrian Devices


Refer to the Mn/DOT TPAR website for additional standards, guidance, and options for designing temporary pedestrian access routes.

<http://www.dot.state.mn.us/trafficeng/workzone/tpar.html>

## NOTES:

1. When crosswalks, sidewalks or other pedestrian facilities are blocked, closed or relocated, temporary facilities shall include accessibility features consistent with the features present in the existing pedestrian facility.
2. The examples show only key typical dimensions. Refer to the Mn/DOT "Temporary Pedestrian Access Route" (TPAR) website (<http://www.dot.state.mn.us/trafficeng/workzone/tpar.html>) for standards, guidance and options when blocking, closing, or relocating pedestrian facilities.
3. Only traffic control devices controlling pedestrian flows are shown. Other devices may be needed to control traffic on the streets.
4. An approved audible message device or tactile message should be provided for sight-impaired pedestrians. When used, a message device should provide a complete physical description of the temporary pedestrian detour including duration, length of (and/or distance to) the by-pass, any restrictions or hazards and project information as listed in note 5 below. The number and location of devices should be determined for each project prior to starting work. Devices may be placed prior to sidewalk work to warn regular users of the planned work.
5. Typical sign message for a temporary pedestrian detour should include information such as the duration of the walkway restrictions (beginning and/or end dates) and a project contact number for 24/7 questions or reporting hazards.
6. The International Symbol of Accessibility should be displayed when any walkway through a work zone has been determined to be TPAR compliant. The Symbol of Accessibility shall not be displayed if persons with disabilities should not use the primary temporary pedestrian detour. The reason for the non-compliance should be posted and an alternate route should be posted when the primary temporary pedestrian detour is non-complaint to TPAR standards.
7. Conditions that are beyond recommended standards should be documented. A walkway is non-compliant if it is missing key ADA elements such as curb ramp(s), truncated domes, and detectable edging. Other restrictions or hazards may include insufficient width or pinch-point widths, traffic conflicts, steep grades, non-continuous railings, tripping hazards, or uneven/rough/soft surface conditions, etc.
8. Pedestrian traffic signal displays controlling closed crosswalks shall be covered.

## CROSSWALK CLOSURES AND PEDESTRIAN DETOURS LAYOUT 84a

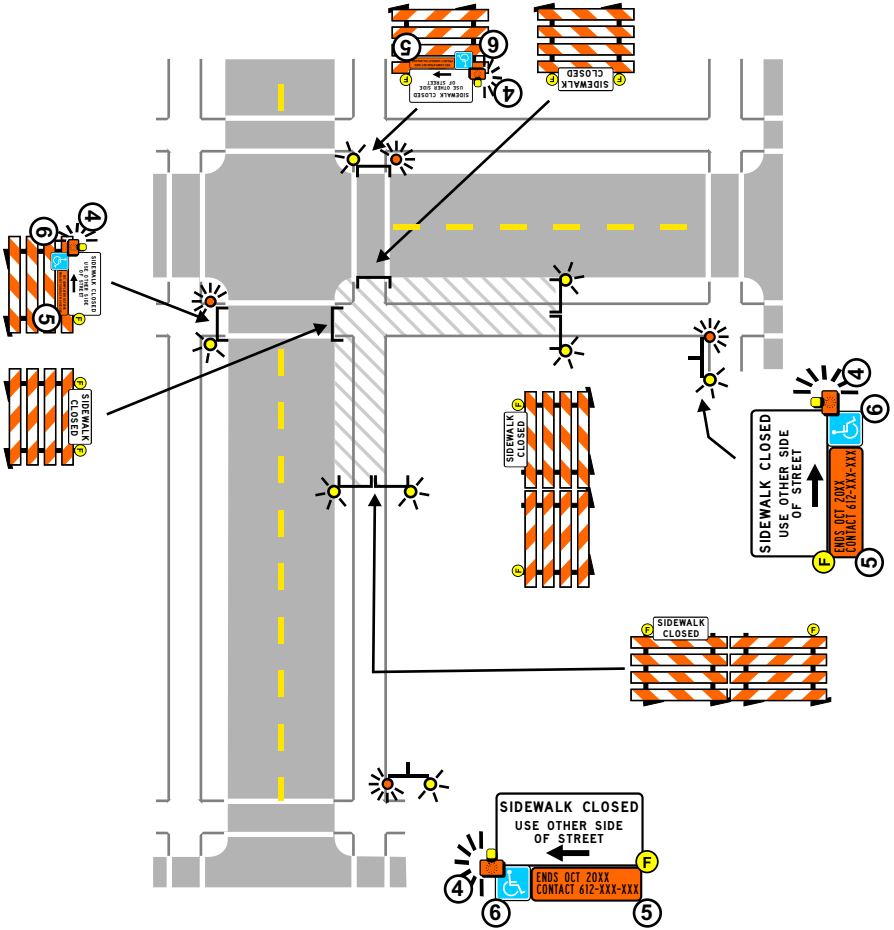

A flasher mounted on the sign or barricade shall be used on all nighttime sidewalk closures.

## CROSSWALK CLOSURES AND PEDESTRIAN DETOURS LAYOUT 84b

3 DAYS or LESS


LAYOUT 84a & b

## NOTES:


1. When crosswalks, sidewalks or other pedestrian facilities are blocked, closed or relocated, temporary facilities shall include accessibility features consistent with the features present in the existing pedestrian facility.
2. The examples show only key typical dimensions. Refer to the Mn/DOT "Temporary Pedestrian Access Route" (TPAR) website (<http://www.dot.state.mn.us/trafficeng/workzone/tpar.html>) for standards, guidance and options when blocking, closing, or relocating pedestrian facilities.
3. Where high speeds and/or high traffic volumes are anticipated, barrier should be used to separate the temporary pedestrian walkway from vehicular traffic. When used, barriers shall be installed as detailed in the MN MUTCD Part 6F.
4. Only traffic control devices controlling pedestrian flows are shown. Other devices may be needed to control traffic on the streets.
5. When both sides of a temporary pedestrian bypass require channelizing devices, then the devices should be a similar type (railing system, barricade, or fencing system), excluding when TTC barrier (such as concrete barrier) is used to protect pedestrians from an open traffic lane.
6. An approved audible message device or tactile message should be provided for sight-impaired pedestrians. When used, a message device should provide a complete physical description of the temporary pedestrian by-pass including duration, length of (and/or distance to) the bypass, any restrictions or hazards and project information as listed in note 7 below. The message device(s) may also describe an alternate route. The number and location of devices should be determined for each project prior to starting work. Devices may be placed prior to sidewalk work to warn regular users of the planned work.
7. Typical sign message for a temporary pedestrian bypass should include information such as the duration of the walkway restrictions (beginning and/or end dates) and a project contact number for 24/7 questions or reporting hazards.
8. The International Symbol of Accessibility should be displayed when any walkway through a work zone has been determined to be TPAR compliant. The Symbol of Accessibility shall not be displayed if persons with disabilities should not enter the temporary pedestrian by-pass. An alternate route should be posted when the temporary pedestrian bypass is non-complaint to TPAR standards.
9. Conditions that are beyond recommended standards should be documented. A walkway is non-compliant if it is missing key ADA elements such as curb ramp(s), truncated domes, and detectable edging. Other restrictions or hazards may include insufficient width or pinch-point widths, traffic conflicts, steep grades, non-continuous railings, tripping hazards, or uneven/rough/soft surface conditions, etc.
10. When a sidewalk is closed but workers are present who will provide assistance or directions to pedestrians, then the devices as shown are not required.

## **SIDEWALK BY-PASS LAYOUT 85a**

## LOW-SPEED ROADWAY

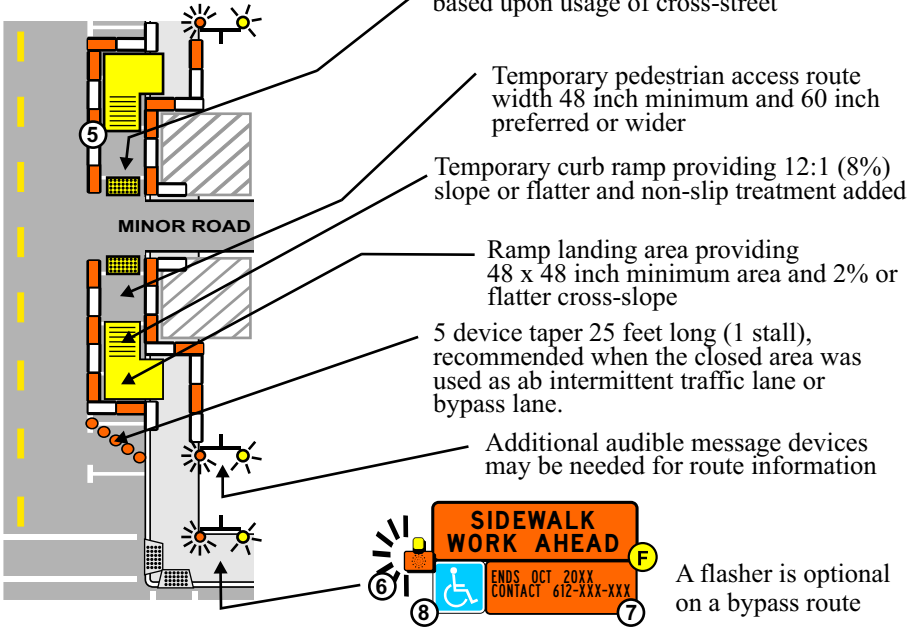

## HIGH-SPEED ROADWAY or LOW-SPEED MULTI-LANE

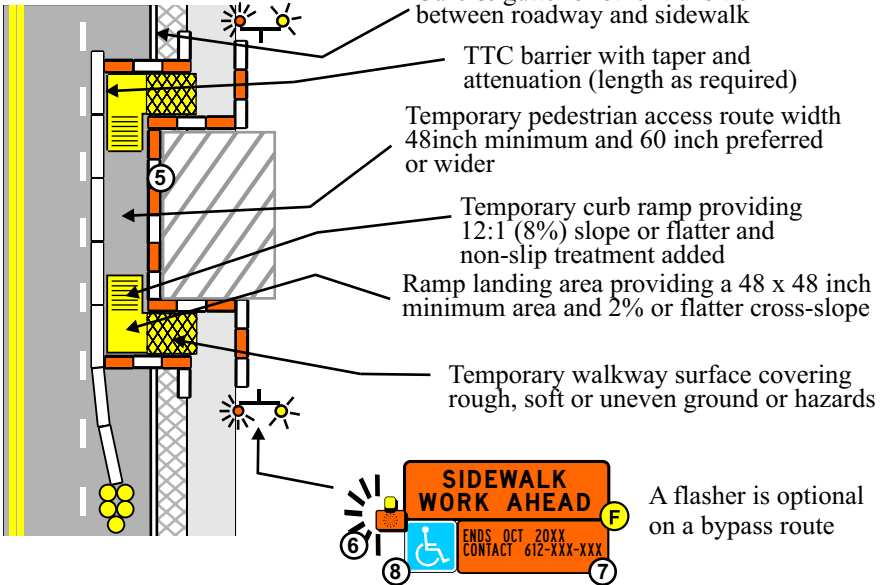

## SIDEWALK BY-PASS LAYOUT 85b